

**Report On Industrial Visit**

1.	Name of the Activity/Event	33/11KV Substation, Haranathapuram		
2.	Date of Activity/Event	08/07/2022		
3.	Organized by/Name of the Committee	Department of EEE		
4.	Place of Activity/Event	Narayana Engineering College, Nellore		
5.	Resource Person/Guest/Organization	1.Mr. M. Leela Mounika 2.Mrs. N.Yamini 3.Mrs. S.Suneetha		
6.	Type of Activity/Event	Industrial Visit		
7.	Activity/Event objectives	1.Breif analysis of 33/11KV Substation 2.How to operation of 33KV/11Kv Substation Operation.		
8.	Participation	Students	Faculty	Total Participation
		30	3	33
9.	General remarks	-		
10.	Enclosures	1. Photos 2.Attendance Report 3.Undertaking forms from students 3.Train Tickets		



It is bring to your kind notice that II B.Tech EEE students was visited 33/11KV Substation, Haranathapuram, Nellore. About 30 members students along with 3 staff members on 08/07/2022.

The Site Engineer was given complete demo about the basic substation configuration and components:

- First Students were entered into the 33/11KV Transformer, the site engineer explain clearly about the working and construction of Transformer and its specifications. Later, he explained how the electrical energy transfer to one circuit to another circuit without change of frequency into busbars.
- After that students were entered into circuit breaker section, where the breaker operate in substation. In this area the site engineer explained about the contacts of relay working and circuit breaker working.
- Finally the students were entered into the Surge arrester. Their they had learn to how the surge arrester working.
- Finally the students were entered into the surege arrester. Their they had learn to how the surge arrester working.
- The Engineer explained with clarity about each and every equipment and also cleared all our doubts. Really we should thank our college management and plant management for giving as permission to visit such a 33/11KV Substation by this visit we gained lot of practical knowledge, it is very useful to us through this practical view we can remember this subject for long time.



Figure:1 &2 Site Engineer Explained the Operation of Substation 33/11KV Transformer to Students

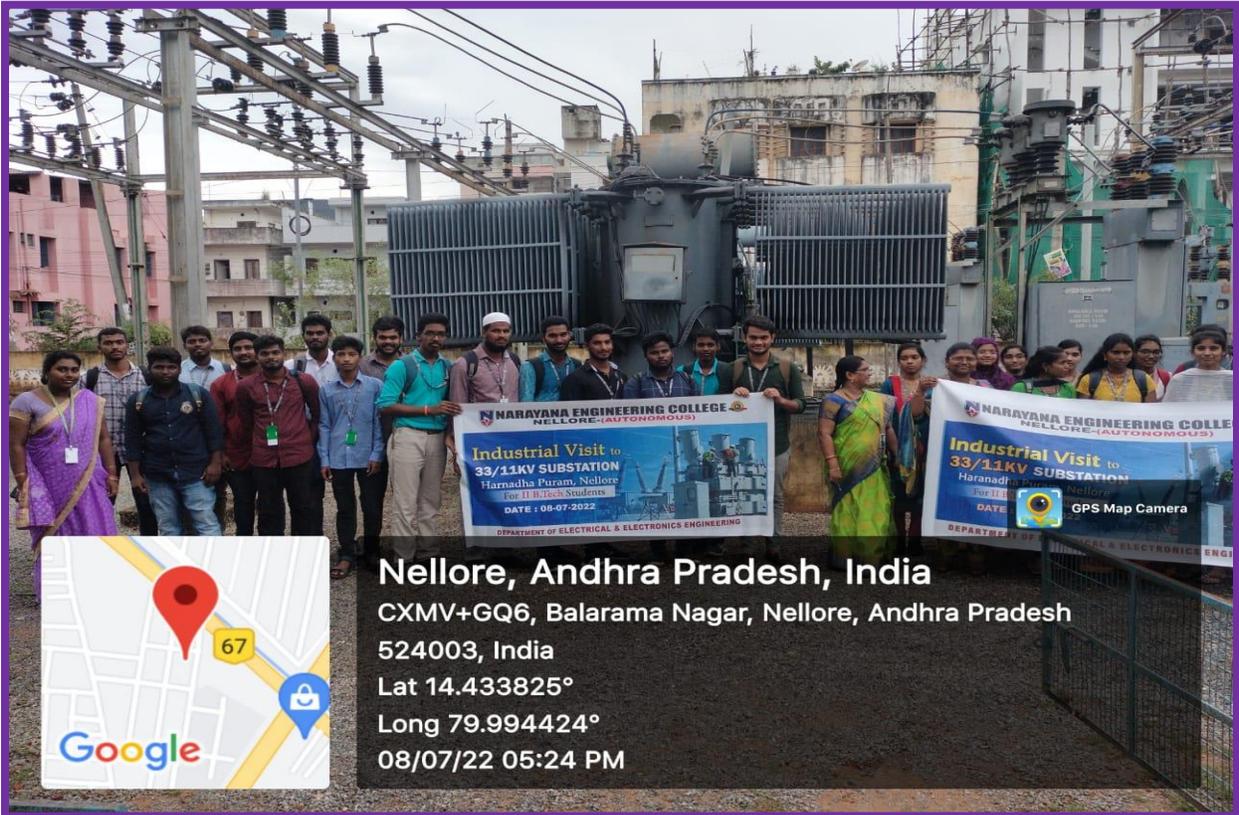

**Nellore, Andhra Pradesh, India**

CXMV+GQ6, Balarama Nagar, Nellore, Andhra Pradesh

524003, India

Lat 14.433825°

Long 79.994424°

08/07/22 05:24 PM